

Tahoe City Public Utility District  
 P. O. Box 5249  
 Tahoe City, CA 96145  
[www.tcpud.org](http://www.tcpud.org)  
 530-583-3796



## Tahoe City Public Utility District 2022 Timberland Water System - Annual Water Quality Consumer Confidence Report

**Este informe contiene información muy importante sobre su agua potable.  
 Tradúzcalo o hable con alguien que lo entienda bien**

To Our Valued Timberland Customers:

The enclosed information is a report of the quality and laboratory analysis of the drinking water that was delivered to the Timberland Water System during the calendar year of 2022. On page two you will find a table showing data from samples collected and contains all detected contaminants in the water, as well as general information on water quality and different standard health effect language for various contaminants. This report can also be viewed on our website at: [www.tcpud.org/ccr/timberland.pdf](http://www.tcpud.org/ccr/timberland.pdf).

While water supplied to Timberland is groundwater which comes from a well drilled deep within the earth, it is important for you to understand all potential sources of drinking water. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the U.S. EPA's Safe Drinking Water Hotline (1-800-426-4791). Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. U.S. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791).

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Contaminants that may be present in source water include:



- Microbial contaminants such as viruses and bacteria that may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife.
- Inorganic contaminants such as salts and metals that can be naturally occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and Herbicides, that may come from a variety of sources such as agriculture, urban storm water runoff and residential uses.
- Organic chemical contaminants including synthetic and volatile organic chemicals that are byproducts of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems.
- Radioactive contaminants, that can be naturally occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the U.S. Environmental Protection Agency (U.S. EPA) and the State Water Resources Control Board (State Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. State Water Board regulations also establish limits for contaminants in bottled water that provide the same protection for public health.

For questions or additional information please call Utilities Superintendent, Dan Lewis, at (530) 580-6330 or the USEPA Safe Drinking Water Hotline at (800) 426-4791 or view their website: <https://www.epa.gov/ground-water-and-drinking-water>. To obtain general District information, to express your views, or to participate in the decision-making process of the TCPUD; you are welcome to attend or view online our Board of Directors meetings, generally held every third Friday of the month at 8:30 AM at 221 Fairway Drive, Tahoe City CA 96145. The District Board of Directors meeting schedule, agendas and videos are available on our website [www.tcpud.org](http://www.tcpud.org) or contact the District Clerk's office at (530) 580-6052.

### Where does your water come from?

All of the drinking water supplied to this water system is classified as groundwater. Sources include wells drilled deep into the ground, providing clean, high quality water that consistently meets all standards without significant treatment. The Timberland water system serves all residents between 2470 and 2716 West Lake Blvd on the lake side and the Timberland Subdivision area. A Source Water Assessment for each active source was completed in 2002. The source is considered most vulnerable to the following activity not associated with any detected contaminants: Sewer Collection Systems. There have been no contaminants detected in the water supply, however the sources are still considered vulnerable to the activities located near the drinking water source. Well construction and security measures should provide protection from most contaminating activities. Copies of all source water assessments are available for review at the TCPUD offices during regular business hours. Upon request, copies can be sent to individuals by contacting the Utilities Superintendent at (530) 580-6330.

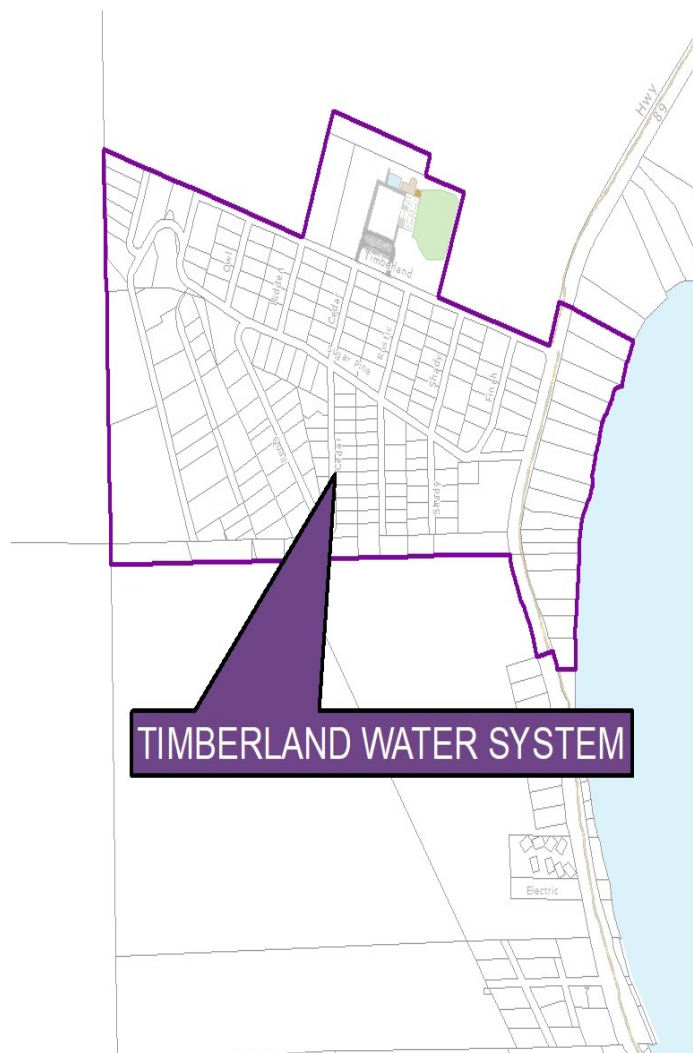

### Water Conservation Links:

- [www.saveourwater.com/](http://www.saveourwater.com/)
- [www.h2ouse.org/water-conservation/](http://www.h2ouse.org/water-conservation/)
- [www.tcpud.org/utility-services/water/water-conservation](http://www.tcpud.org/utility-services/water/water-conservation)
- [www.epa.gov/watersense/](http://www.epa.gov/watersense/)
- [www.wateruseitwisely.com/100-ways-to-serve](http://www.wateruseitwisely.com/100-ways-to-serve)

**Detected Compounds**

The State allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of our data, though representative, are more than one year old. If a substance or contaminant is not listed, it is either not detected above the detection limit in our sources or not required to be reported or sampled.

Identify your system >				Timberland		
Contaminant (Units)	Sample Year	MCL	PHG (MCLG)	Well #1	Violation	Major Origins in Drinking Water
<b>Primary Drinking Water Standards (PDWS)</b>						
Aluminum (ppm)	2016	1	0.6	0.13	NO	Erosion of natural deposits; residue from some surface water treatment processes
Barium (ppb)	2016	1000	1000	15.81	NO	Discharges of oil drilling wastes and from metal refineries; erosion of natural deposits
<b>Secondary Drinking Water Standards (SDWS)</b>						
Calcium (ppm)	2022	N/A	N/A	18	N/A	Leaching from natural deposits
Magnesium (ppm)	2022	N/A	N/A	9.2	N/A	Leaching from natural deposits
Sodium (ppm)	2022	N/A	N/A	5.7	N/A	Leaching from natural deposits
Specific Conductance [E.C.] (µS/cm)	2022	1600	N/A	200	NO	Substances that form ions when in water
Total Alkalinity as [CaCO3] (ppm)	2022	N/A	N/A	99	NO	Leaching from natural deposits
Total Dissolved Solids (ppm)	2022	1000	N/A	110	NO	Erosion of natural deposits
Total Hardness [as CaCO3] (ppm)	2022	N/A	N/A	84	N/A	Leaching from natural deposits
Turbidity (NTU)	2022	5	N/A	0	NO	Movement of sediments and minute deposits
<b>Microbiological Monitoring</b>						
Total Coliform (P/A)	2022	TT	0 P	36T/ 31A/ 5P (Note 1)	NO (Note 1)	Naturally present in the environment

**Lead and Copper Sampling Results**

Water System	Constituent	Year Sampled	# of Sites Sampled	90th % Results	# of Sites Exceeding Action Level (AL)	Action Level (AL)	PHG
Timberland	Lead (ppb)	2020	5	0	0	15	0.2
	Copper (ppm)		5	0.055	0	1.3	0.3

Tahoe Lake Elementary (at Rideout) was tested for Lead in 2019.

Typical Sources	Lead: Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits
	Copper: Internal corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives

**Este informe contiene información importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien.**

**Terms and Abbreviations Used in This Report**

A	Number of tests absent of bacteria	PDWS	Primary Drinking Water Standards. MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.
AL	Regulatory Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.	PHG	Public Health Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.
Level 1 Assessment	A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.	ppb	parts per billion or micrograms per liter (ug/l): Parts contaminant for every 1 billion parts of water.
MCL	Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.	ppm	parts per million or milligrams per liter (mg/l): Parts contaminant for every 1 million parts of water.
MCLG	Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency.	SDWS	Secondary Drinking Water Standards. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.
NA	Not Applicable	T	Number of tests for bacteria (Laboratory analysis)
N/R	Not Regulated or Not Required	TT	Treatment Technique: A required process intended to reduce the level of a contaminant in drinking water.
NTU	Nephelometric Turbidity Unit: Measure of water clarity using light scattering	Units	Number of units measured
P	Number of tests detecting presence of bacteria	µS	Microsiemens: Measure of electrical current flow through a solution

**Health Effects and General Information**

**Lead:** If present, elevated levels of lead can cause serious health problems, especially for pregnant women and your children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. TCPUD is responsible for providing high quality drinking water but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you do so, you may wish to collect the flushed water and reuse it for another beneficial purpose, such as watering plants. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/lead>.

**Note 1:** Coliforms are bacteria that are naturally present in the environment and used as an indicator that other, potentially harmful, waterborne pathogens may be present, or that a potential pathway exists through which contamination may enter the drinking water distribution system. We found coliforms indicating the need to search for potential problems in the water treatment or distribution system. When this occurs, we are required to conduct assessment(s) to identify and to correct any problems that were found during these assessments. **During the past year we were required to conduct one Level 1 Assessment. One Level 1 Assessment was completed in May/June 2022.** During our assessment we observed evidence of debris build-up around the Distribution Tank vent which may have entered the tank during a storm event. We took one corrective action by installing an additional barrier around the tank vent to prevent re-occurrence, and disinfecting the tank. Samples were collected following this procedure, once chlorine residuals were diminished, which showed no further detections of Coliform.